



SPLIT DUCT (LOCKING TONGUE & GROOVE)
10 FT. LENGTHS

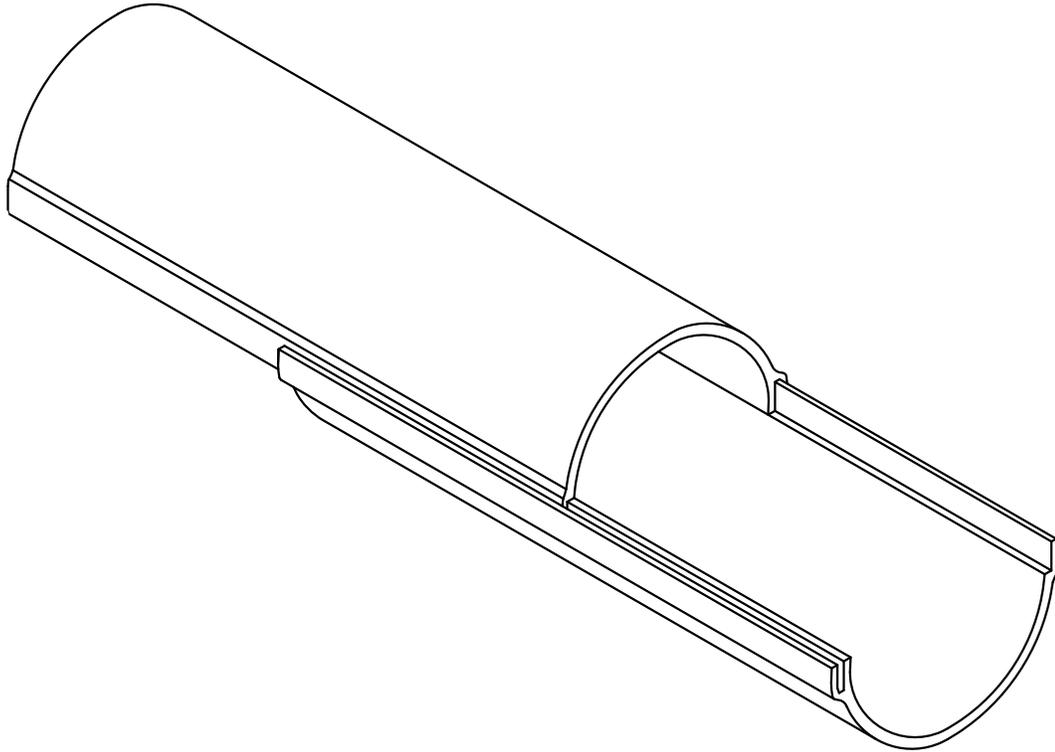

MINIMUM WALL THICKNESSES

- 3" D.B. ——— 0.118"
- 4" D.B. ——— 0.154"
- 5" D.B. ——— 0.191"
- 6" D.B. ——— 0.227"

SPLIT DUCT IS USED TO COVER
EXISTING UNDERGROUND CABLES
OR REPAIRING DAMAGED DUCT
WITHOUT CUTTING OR RESPLICING
EXISTING CABLES. MADE OF
P.V.C. DUCT.

A.S.T.M. F 512
RATED 90° C



APPROVED:
Richard J. Baker
CHIEF, CONDUIT DIVISION
Khalil Zane
DIRECTOR, DEPARTMENT OF TRANSPORTATION

CITY OF BALTIMORE
DEPARTMENT OF TRANSPORTATION
CONDUIT DIVISION

SPLIT DUCT

| ISSUED | REVISED | REVISED |
|------------------------------------|--------------|---------|
| 8 / 2010 | | |
| STANDARD NO. BC 802.03-4 | | |
| SCALE : NONE | SHEET 4 OF 4 | |